

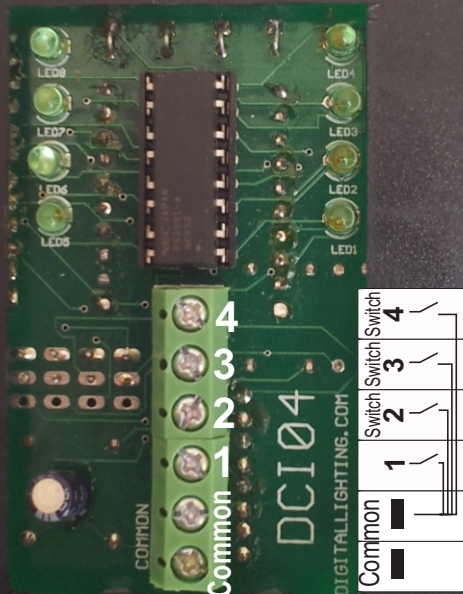


PROTOCOL DCI-04 Control Station

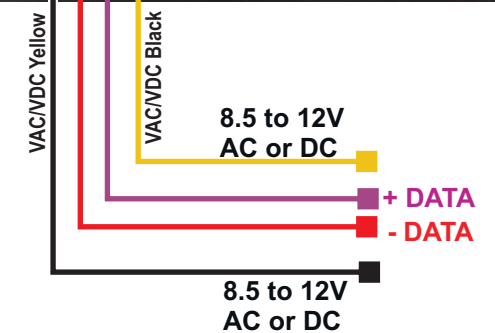

DCI04
Dry contact
Switches
Inputs

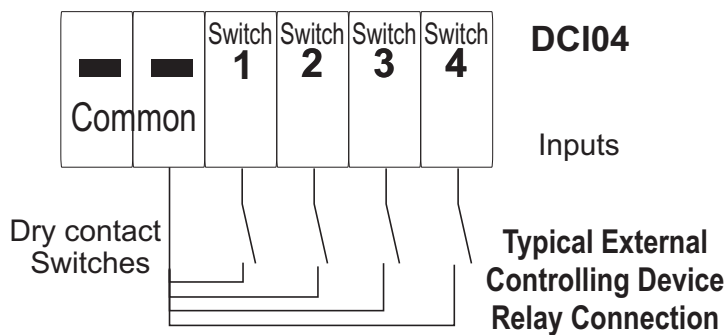

Connect to
PROTOCOL network Bus
like a PSFxx station

DCI-04 PROTOCOL control Station

- Accepts 4 dry contact switches from other devices.
- 4 switches activate the first column of a PSF08 keypad station (Buttons 1,2,3,4)
- Addressed and programmed as a PSF08 station.
- Switches 1,2,3,4 are the only ones that are active.
- Mounts on a deep 1 gang box (2" minimum depth)

Date 01/20/2016	Digital Lighting Systems		
Drawn By MC	12302 SW 128th ct, Miami, FL 33126 (305)969-8442		
Appd. By EMK	Description Dry-Contact Inputs Interface		
Scale None	Wiring instructions		
Sheet 1 Of 1	Drawing No.	Part No. DCI-04	Revision